

ASHRAE Standard 140-2011

Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200

Results for Autodesk Green Building Studio September 8, 2013
(GBS Sep2013)

vs.

Informative Annex B16, Section B16.5.1 Example Results

Prepared By
Autodesk Green Building Studio
(Autodesk GBS)

Results Developed
08-Sep-2013

ASHRAE Standard 140-2011
Participating Organizations and Computer Programs for
Quasi-analytical Solutions and Example Simulation Results
Section 5.3 - HVAC Equipment Performance Tests CE100-CE200

The quasi-analytical solutions and programs used to generate the example simulation results are described in Table B17-1. The first column of Table B17-1 ("Model"), indicates the proper program name and version number, or indicates a quasi-analytical solution.

The second column ("Authoring Organization") indicates the national research facility, university, or industry organization with expertise in building science that wrote the simulation software or did the quasi-analytical solutions.

The third column ("Implemented By") indicates the national research facility, university, or industry organization with expertise in building science that performed the simulations or did the quasi-analytical solutions.

The entries in the fourth column are the abbreviations for the simulations and quasi-analytical solutions generally used in the tables and charts which follow.

See Standard 140, Annex B17 for further details.

TABLE B17-1
Participating Organizations and Computer Programs

Model	Authoring Organization	Implemented By	Abbreviation
Quasi-Analytical solution with ideal controller model	Hochschule Technik & Architektur Luzern, Switzerland (HTAL)	Hochschule Technik & Architektur Luzern, Switzerland	HTAL1
Quasi-Analytical solution with realistic controller model	Hochschule Technik & Architektur Luzern, Switzerland	Hochschule Technik & Architektur Luzern, Switzerland	HTAL2
Quasi-Analytical Solution with ideal controller model	Technische Universität Dresden, Germany (TUD)	Technische Universität Dresden, Germany	TUD
CA-SIS V1	Electricité de France, France (EDF)	Electricité de France, France	CA-SIS
CLIM2000 2.1.6	Electricité de France, France	Electricité de France, France	CLM2000
DOE-2.1E-088	LANL/LBNL/ESTSC, ^{a,b,c} USA	CIEMAT, ^d Spain	DOE21E/CIEMAT DOE2.1-E/CIEMAT
DOE-2.1E-133	LANL/LBNL/JJH, ^{a,b,e} USA LBNL/UIUC/CERL/OSU/GARD	NREL/JNA, ^f USA	DOE21E/NREL DOE2.1-E/NREL
ENERGYPLUS 1.0.0.023	Analytics/FSEC/DOE-OBT, ^{a,g,h,i,j,k}	GARD Analytics, USA	E+ EnergyPlus
TRNSYS 14.2-TUD with ideal controller model	University of Wisconsin, USA; Technische Universität Dresden, Ger.	Technische Universität Dresden, Germany	TRN-id TRNSYS-ideal
TRNSYS 14.2-TUD with real controller model	University of Wisconsin, USA; Technische Universität Dresden, Ger.	Technische Universität Dresden, Germany	TRN-re TRNSYS-real

^aLANL: Los Alamos National Laboratory, United States

^bLBNL: Lawrence Berkeley National Laboratory

^cESTSC: Energy Science and Technology Software Center (at Oak Ridge National Laboratory, USA)

^dCIEMAT: Centro de Investigaciones Energeticas, Medioambientales y Tecnologicas

^eJJH: James J. Hirsch & Associates

^fNREL/JNA: National Renewable Energy Laboratory/J. Neymark & Associates

^gUIUC: University of Illinois Urbana/Champaign

^hCERL: U.S. Army Corps of Engineers, Construction Engineering Research Laboratories

ⁱOSU: Oklahoma State University

^jFSEC: University of Central Florida, Florida Solar Energy Center

^kDOE-OBT: U.S. Department of Energy, Office of Building Technology, State and Community Programs,

Energy Efficiency and Renewable Energy

**ASHRAE Standard 140-2010 Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
 k Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example
 By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013**

List of Tables

<i>Table</i>	<i>Description</i>	<i>Sheet Tab</i>	<i>Cell Range</i>
B16.5.1-1	Space Cooling Electricity Consumption	Q-Prt1	A7 – Q76
B16.5.1-2	COP: Mean, and (Max-Min)/Mean	Q-Prt2	A7 – Q42
B16.5.1-3	Coil Loads: Total, Sensible, and Latent	Q-Prt3	A7 – Q59
B16.5.1-4	Sensible Coil Load minus Zone Load (Fan Heat)	Q-Prt3	A60 – Q78
B16.5.1-5	Zone Loads: Total, Sensible, and Latent	Q-Prt4	A7 – Q59
B16.5.1-6	Latent Coil Load minus Zone Load (Should be 0)	Q-Prt4	A60 – Q78
B16.5.1-7	Sensitivities for Space Cooling Electricity Consumption	Q-Prt5	A7 – Q96
B16.5.1-8	Sensitivities for COP and Coil Loads	Q-Prt6	A7 – Q96
B16.5.1-9	Indoor Drybulb Temperature: Mean and (Max-Min)/Mean	Q-Prt7	A7 – Q41
B16.5.1-10	Humidity Ratio: Mean and (Max-Min)/Mean	Q-Prt7	A43 – Q78

ASHRAE Standard 140-2010 Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013

List of Figures

<i>Figure</i>	<i>Title</i>	<i>Sheet Tab</i>
B16.5.1-1	HVAC BESTEST: Mean COP	Fig B16.5.1-1 COP
B16.5.1-2	HVAC BESTEST: (Maximum - Minimum)/Mean COP	Fig B16.5.1-2 COPvar
B16.5.1-3	HVAC BESTEST: Mean COP Sensitivities	Fig B16.5.1-3 delCOP
B16.5.1-4	HVAC BESTEST: Total Space Cooling Electricity Consumption	Fig B16.5.1-4 Qtot
B16.5.1-5	HVAC BESTEST: Total Space Cooling Electricity Sensitivities	Fig B16.5.1-5 dQtot
B16.5.1-6	HVAC BESTEST: Compressor Electricity Consumption	Fig B16.5.1-6 Qcomp
B16.5.1-7	HVAC BESTEST: Total Compressor Electricity Sensitivities	Fig B16.5.1-7 dQcomp
B16.5.1-8	HVAC BESTEST: Total Indoor (Supply) Fan Electricity Consumption	Fig B16.5.1-8 Qidfan
B16.5.1-9	HVAC BESTEST: Indoor (Supply) Fan Electricity Sensitivities	Fig B16.5.1-9 dQidfan
B16.5.1-10	HVAC BESTEST: Outdoor (Condenser) Fan Electricity Consumption	Fig B16.5.1-10 Qodfan
B16.5.1-11	HVAC BESTEST: Outdoor (Condenser) Fan Electricity Sensitivities	Fig B16.5.1-11 dQodfan
B16.5.1-12	HVAC BESTEST: Total Coil Load	Fig B16.5.1-12 Qctot
B16.5.1-13	HVAC BESTEST: Total Coil Load Sensitivities	Fig B16.5.1-13 dQctot
B16.5.1-14	HVAC BESTEST: Sensible Coil Load	Fig B16.5.1-14 QCsens
B16.5.1-15	HVAC BESTEST: Sensible Coil Load Sensitivities	Fig B16.5.1-15 dQCsens
B16.5.1-16	HVAC BESTEST: Latent Coil Load	Fig B16.5.1-16 Qclat
B16.5.1-17	HVAC BESTEST: Latent Coil Load Sensitivities	Fig B16.5.1-17 dQclat
B16.5.1-18	HVAC BESTEST: Mean Indoor Drybulb Temperature	Fig B16.5.1-18 IDB
B16.5.1-19	HVAC BESTEST: (Maximum - Minimum)/Mean Indoor Drybulb Temperature	Fig B16.5.1-19 IDBvar
B16.5.1-20	HVAC BESTEST: Mean Indoor Humidity Ratio	Fig B16.5.1-20 Humrat
B16.5.1-21	HVAC BESTEST: (Maximum - Minimum)/Mean Indoor Humidity Ratio	Fig B16.5.1-21 Humratvar
B16.5.1-22	HVAC BESTEST: Total Zone Load	Fig B16.5.1-22 QZtot
B16.5.1-23	HVAC BESTEST: Sensible Zone Load	Fig B16.5.1-23 QZsens
B16.5.1-24	HVAC BESTEST: Latent Zone Load	Fig B16.5.1-24 QZlat
B16.5.1-25	HVAC BESTEST: Sensible Coil Load - Zone Load (Fan Heat)	Fig B16.5.1-25 QZfan
B16.5.1-26	HVAC BESTEST: Latent Coil Load - Latent Zone Load (Should = 0)	Fig B16.5.1-26 QCL-QZL

**ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-1. Space Cooling Electricity Consumption

Energy Consumption, Total (kWh,e)								Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			TUD	HTAL1	HTAL2	GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*				Autodesk GBS	Autodesk GBS v3.4
CE100	1531	1530	1521	1519	1520	1522	1512	1531	1.2%		1531	1531	1531	1521	1521
CE110	1077	1089	1061	1065	1069	1067	1061	1089	2.6%		1076	1077	1077	1066	1066
CE120	1012	1012	1011	1003	1006	1007	1002	1012	1.0%		1013	1011	1011	1003	1003
CE130	110	109	105	106	109	109	110	105	4.3%		111	110	110	106	106
CE140	68	69	65	66	68	68	69	65	5.8%		69	69	68	66	66
CE150	1208	1207	1202	1183	1197	1199	1183	1208	2.1%		1206	1207	1207	1183	1183
CE160	1140	1139	1138	1107	1132	1137	1107	1140	2.9%		1140	1139	1139	1108	1108
CE165	1502	1501	1499	1470	1491	1500	1470	1502	2.1%		1498	1500	1500	1472	1472
CE170	638	638	629	620	635	636	620	638	2.8%		641	638	638	621	621
CE180	1083	1082	1077	1080	1082	1081	1077	1083	0.5%		1083	1082	1082	1077	1077
CE185	1544	1543	1541	1547	1540	1542	1538	1547	0.6%		1545	1543	1543	1538	1538
CE190	164	164	160	160	164	164	160	165	3.1%		165	164	164	162	162
CE195	250	250	245	246	250	250	245	252	2.7%		252	250	250	248	248
CE200	1477	1464	1468	1440	1465	1480	1440	1480	2.7%		1476	1477	1477	1444	1444
Energy Consumption, Compressor (kWh,e)								Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			TUD	HTAL1	HTAL2	GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*				Autodesk GBS	Autodesk GBS v3.4
CE100	1319	1318	1307	1311	1311	1311	1303	1303	1319	1.2%	1319	1319	1319	1313	1313
CE110	889	899	866	883	879	879	876	866	899	3.7%	888	889	889	884	884
CE120	840	840	850	838	836	832	832	850	2.2%		841	839	839	838	838
CE130	95	94	93	93	94	95	93	95	2.1%		95	94	94	93	93
CE140	57	57	55	56	56	57	57	55	3.9%		57	57	56	56	56
CE150	1000	999	1007	982	992	987	982	1007	2.5%		999	999	999	982	982
CE160	950	949	963	926	947	944	926	963	3.9%		950	949	949	928	928
CE165	1283	1281	1291	1256	1280	1272	1256	1291	2.8%		1279	1280	1280	1258	1258
CE170	531	530	539	523	528	529	523	539	3.0%		533	530	530	524	524
CE180	909	908	914	912	907	906	906	914	0.9%		908	908	908	911	911
CE185	1340	1339	1343	1344	1337	1334	1334	1344	0.7%		1340	1339	1338	1337	1337
CE190	138	138	139	138	138	138	138	139	1.4%		138	138	138	139	139
CE195	217	217	219	217	216	218	216	219	1.1%		219	217	217	219	219
CE200	1250	1239	1249	1218	1253	1253	1218	1253	2.8%		1249	1250	1250	1222	1222
Energy Consumption, Supply Fan (kWh,e)								Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			TUD	HTAL1	HTAL2	GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*				Autodesk GBS	Autodesk GBS v3.4
CE100	144	144	145	141	144	144	142	141	145	2.9%	144	144	144	141	141
CE110	128	129	133	122	128	128	127	122	133	8.5%	128	128	128	122	122
CE120	117	117	110	110	116	117	115	110	117	6.3%	117	117	117	110	110
CE130	10	10	8	8	10	10	10	8	10	23.1%	10	10	10	8	8
CE140	8	8	7	6	8	8	8	6	8	27.2%	8	8	8	6	6
CE150	141	141	133	136	140	141	139	133	141	5.7%	141	141	141	136	136
CE160	129	129	119	121	128	129	128	119	129	7.8%	129	129	129	121	121
CE165	149	150	142	145	149	149	148	142	150	5.6%	149	149	149	145	145
CE170	73	73	61	63	73	73	73	61	73	16.1%	74	73	73	63	63
CE180	118	119	111	112	118	118	118	111	119	6.9%	119	119	119	111	111
CE185	139	139	135	137	139	139	139	135	139	3.0%	139	139	139	135	135
CE190	18	18	14	14	18	18	18	14	18	22.9%	18	18	18	15	15
CE195	23	23	18	18	23	23	23	18	23	23.3%	23	23	23	18	18
CE200	154	153	149	151	153	155	155	149	155	3.5%	154	155	155	151	151
Energy Consumption, Condenser Fan (kWh,e)								Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			TUD	HTAL1	HTAL2	GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*				Autodesk GBS	Autodesk GBS v3.4
CE100	68	68	68	67	67	67	67	67	68	2.0%	68	68	68	67	67
CE110	60	61	62	60	60	59	59	62	4.9%		60	60	60	60	60
CE120	55	55	51	55	55	54	51	55	6.5%		55	55	55	55	55
CE130	5	5	4	5	5	5	4	5	22.7%		5	5	5	5	5
CE140	4	4	3	4	4	4	3	4	19.3%		4	4	4	4	4
CE150	66	66	62	65	66	65	62	66	5.6%		66	66	66	65	65
CE160	61	61	56	60	61	60	56	61	8.4%		61	61	61	60	60
CE165	70	70	67	69	70	69	67	70	5.1%		70	70	70	69	69
CE170	34	34	29	34	34	34	29	34	16.1%		35	34	34	34	34
CE180	56	56	52	56	56	55	52	56	7.1%		56	56	56	56	56
CE185	65	65	63	66	65	65	63	66	3.9%		65	65	65	65	65
CE190	8	9	7	8	8	9	7	9	27.7%		9	9	9	9	9
CE195	11	11	8	11	11	11	8	11	25.2%		11	11	11	11	11
CE200	73	72	70	71	73	73	70	73	4.1%		73	73	73	71	71

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

**ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-2. COP: Mean, and (Max-Min)/Mean

Mean COP								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE100	2.39	2.39	2.43	2.41	2.40	2.40	2.42	2.39	2.43	1.7%	2.39	2.39	2.39	2.40	2.40
CE110	3.38	3.34	3.46	3.41	3.40	3.41	3.43	3.34	3.46	3.5%	3.38	3.38	3.38	3.41	3.41
CE120	3.59	3.59	3.61	3.62	3.61	3.61	3.63	3.59	3.63	1.1%	3.59	3.59	3.59	3.62	3.62
CE130	1.91	1.91	1.98	1.95	1.90	1.92	1.92	1.90	1.98	3.8%	1.89	1.91	1.91	1.95	1.95
CE140	2.77	2.73	2.92	2.85	2.77	2.80	2.80	2.73	2.92	6.6%	2.75	2.77	2.77	2.85	2.85
CE150	3.62	3.63	3.67	3.70	3.65	3.65	3.67	3.62	3.70	2.2%	3.63	3.63	3.63	3.70	3.70
CE160	3.84	3.84	3.87	3.95	3.86	3.85	3.86	3.84	3.95	2.9%	3.83	3.84	3.84	3.94	3.94
CE165	2.92	2.92	2.95	2.99	2.94	2.93	2.94	2.92	2.99	2.2%	2.93	2.93	2.93	2.98	2.98
CE170	3.38	3.39	3.44	3.48	3.40	3.39	3.40	3.38	3.48	2.9%	3.37	3.39	3.39	3.47	3.47
CE180	4.04	4.04	4.08	4.03	4.04	4.05	4.06	4.03	4.08	1.4%	4.04	4.04	4.04	4.06	4.06
CE185	2.85	2.85	2.87	2.82	2.85	2.85	2.86	2.82	2.87	1.8%	2.85	2.85	2.85	2.86	2.86
CE190	3.41	3.41	3.49	3.46	3.39	3.41	3.40	3.39	3.49	2.7%	3.39	3.41	3.41	3.44	3.44
CE195	2.31	2.31	2.36	2.34	2.30	2.32	2.31	2.30	2.36	2.5%	2.29	2.31	2.31	2.32	2.32
CE200	3.62	3.61	3.67	3.71	3.65	3.61	3.61	3.61	3.71	2.7%	3.62	3.62	3.62	3.70	3.70
(Max - Min)/Mean COP								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE100	0.000	0.001	0.002	0.001	0.003	0.000	0.000	0.000	0.003	----	0.000	0.000	0.000	0.000	0.000
CE110	0.000	0.010	0.002	0.001	0.003	0.000	0.011	0.000	0.011	----	0.000	0.000	0.000	0.000	0.000
CE120	0.000	0.004	0.001	0.001	0.003	0.000	0.012	0.000	0.012	----	0.000	0.000	0.000	0.000	0.000
CE130	0.000	0.038	0.013	0.009	0.004	0.000	0.172	0.000	0.172	----	0.000	0.000	0.000	0.000	0.000
CE140	0.000	0.056	0.011	0.019	0.004	0.000	0.204	0.000	0.204	----	0.000	0.000	0.000	0.000	0.000
CE150	0.003	0.003	0.001	0.005	0.011	0.000	0.009	0.000	0.011	----	0.000	0.001	0.000	0.000	0.000
CE160	0.003	0.005	0.001	0.003	0.011	0.000	0.010	0.000	0.011	----	0.000	0.000	0.000	0.000	0.000
CE165	0.010	0.003	0.001	0.003	0.012	0.000	0.008	0.000	0.012	----	0.000	0.000	0.000	0.000	0.000
CE170	0.000	0.006	0.002	0.004	0.015	0.000	0.043	0.000	0.043	----	0.000	0.000	0.000	0.000	0.000
CE180	0.005	0.002	0.002	0.010	0.029	0.000	0.012	0.000	0.029	----	0.000	0.000	0.000	0.000	0.000
CE185	0.007	0.004	0.002	0.010	0.034	0.000	0.009	0.000	0.034	----	0.000	0.000	0.000	0.000	0.000
CE190	0.000	0.023	0.007	0.019	0.040	0.000	0.101	0.000	0.101	----	0.000	0.000	0.000	0.000	0.000
CE195	0.000	0.017	0.008	0.017	0.043	0.000	0.086	0.000	0.086	----	0.000	0.000	0.000	0.000	0.000
CE200	0.006	0.000	0.000	0.005	0.012	0.000	0.000	0.000	0.012	----	0.000	0.000	0.000	0.000	0.000

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

**ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-3. Coil Loads: Total, Sensible, and Latent

Coil Load, Total (kWh,thermal)									Statistics, All Results				Analytical			08-Sep-13	
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4 Autodesk GBS v3.4		
CE100	3800	3800	3841	3794	3798	3800	3798	1.3%	3794	3841	3800	3800	3800	3795	3795		
CE110	3765	3766	3804	3756	3763	3765	3763	1.3%	3756	3804	3765	3765	3765	3758	3758		
CE120	3749	3749	3763	3739	3747	3748	3747	0.6%	3739	3763	3749	3749	3749	3740	3740		
CE130	219	219	216	215	217	219	220	2.1%	215	220	219	219	219	215	215		
CE140	198	198	196	195	196	198	199	2.0%	195	199	198	198	197	195	195		
CE150	4517	4517	4543	4528	4509	4517	4515	0.8%	4509	4543	4518	4517	4518	4527	4527		
CE160	4501	4500	4516	4508	4491	4500	4499	0.6%	4491	4516	4501	4500	4500	4507	4507		
CE165	4538	4538	4567	4549	4529	4537	4535	0.9%	4529	4567	4537	4537	4538	4548	4548		
CE170	2233	2232	2226	2237	2225	2232	2232	0.5%	2225	2237	2232	2232	2233	2236	2236		
CE180	4495	4495	4510	4535	4481	4495	4494	1.2%	4481	4535	4495	4495	4494	4561	4561		
CE185	4507	4535	4565	4583	4523	4535	4534	1.7%	4507	4583	4535	4535	4534	4606	4606		
CE190	578	577	573	579	574	577	578	1.0%	573	579	578	577	578	581	581		
CE195	602	601	595	602	598	601	601	1.1%	595	602	601	601	601	605	605		
CE200	5498	5436	5534	5522	5484	5498	5498	1.8%	5436	5534	5498	5498	5498	5521	5521		
Coil Load, Sensible (kWh,thermal)									Statistics, All Results				Analytical			08-Sep-13	
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4 Autodesk GBS v3.4		
CE100	3800	3800	3841	3794	3798	3800	3798	1.3%	3794	3841	3800	3800	3800	3795	3795		
CE110	3765	3766	3804	3756	3763	3765	3763	1.3%	3756	3804	3765	3765	3765	3758	3758		
CE120	3749	3749	3763	3739	3747	3748	3747	0.6%	3739	3763	3749	3749	3749	3740	3740		
CE130	219	219	216	215	217	219	220	2.1%	215	220	219	219	219	215	215		
CE140	198	198	196	195	196	198	199	2.0%	195	199	198	198	197	195	195		
CE150	3778	3778	3804	3786	3776	3778	3776	0.7%	3776	3804	3778	3778	3779	3788	3788		
CE160	3761	3761	3777	3769	3759	3761	3760	0.5%	3759	3777	3761	3761	3761	3768	3768		
CE165	3798	3798	3828	3809	3795	3798	3796	0.9%	3795	3828	3798	3798	3799	3808	3808		
CE170	1493	1493	1487	1498	1491	1492	1492	0.7%	1487	1498	1493	1493	1493	1497	1497		
CE180	1537	1538	1553	1607	1537	1538	1537	4.5%	1537	1607	1538	1538	1538	1604	1604		
CE185	1548	1578	1608	1653	1577	1578	1577	6.6%	1548	1653	1578	1578	1578	1649	1649		
CE190	208	208	203	212	206	208	208	4.4%	203	212	208	208	208	211	211		
CE195	232	232	226	235	230	231	232	4.1%	226	235	232	232	232	235	235		
CE200	4276	4215	4313	4303	4274	4277	4277	2.3%	4215	4313	4277	4277	4277	4300	4300		
Coil Load, Latent (kWh,thermal)									Statistics, All Results				Analytical			08-Sep-13	
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4 Autodesk GBS v3.4		
CE100	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0		
CE110	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0		
CE120	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0		
CE130	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0		
CE140	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0		
CE150	739	739	739	742	733	739	739	1.2%	733	742	739	739	739	739	739		
CE160	740	739	739	739	732	739	739	1.1%	732	740	739	739	739	739	739		
CE165	740	739	739	740	733	739	739	1.0%	733	740	739	739	739	739	739		
CE170	740	739	739	739	734	739	739	0.9%	734	740	739	739	739	739	739		
CE180	2958	2957	2957	2928	2944	2957	2957	1.0%	2928	2958	2957	2956	2956	2957	2957		
CE185	2959	2957	2957	2930	2946	2957	2957	1.0%	2930	2959	2958	2957	2956	2957	2957		
CE190	370	370	370	366	368	370	370	1.0%	366	370	370	370	370	370	370		
CE195	370	370	370	367	368	370	370	0.9%	367	370	370	370	370	370	370		
CE200	1222	1221	1221	1219	1210	1221	1221	1.0%	1210	1222	1221	1221	1221	1221	1221		

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

Table B16.5.1-4. Sensible Coil Load minus Zone Load (Fan Heat)

Sensible Coil - Zone Load, (Fan Heat) (kWh,thermal)									Statistics, All Results				Analytical			08-Sep-13	
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4 Autodesk GBS v3.4		
CE100	144	144	187	139	144	144	142	33.6%	139	187	144	144	144	141	141		
CE110	128	129	168	119	128	128	127	38.2%	119	168	128	128	128	122	122		
CE120	117	117	133	108	116	117	115	21.8%	108	133	117	117	117	109	109		
CE130	10	10	8	8	10	10	10	27.0%	8	10	10	10	10	8	8		
CE140	8	8	7	6	8	8	8	25.6%	6	8	8	8	8	6	6		
CE150	141	141	168	149	140	141	139	20.2%	139	168	141	141	142	151	151		
CE160	129	129	147	137	129	129	128	14.3%	128	147	129	129	129	137	137		
CE165	149	149	181	161	149	149	148	22.4%	148	181	149	149	150	161	161		
CE170	73	73	69	79	73	73	73	14.2%	69	79	74	73	74	79	79		
CE180	117	118	135	188	119	118	118	60.1%	117	188	118	119	118	186	186		
CE185	109	139	171	215	140	139	139	76.5%	109	215	139	139	139	212	212		
CE190	18	18	15	24	18	18	18	51.0%	15	24	18	18	18	24	24		
CE195	23	23	18	28	23	23	23	40.8%	18	28	23	23	23	28	28		
CE200	154	153	193	181	154	155	155	25.7%	153	193	154	155	155	180	180		

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

**ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013**

Note: The statistics in the tables below are based on the Standard 140 informative example results.
These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-5. Zone Loads: Total, Sensible, and Latent

Zone Load, Total (kWh,thermal)									Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4	
CE100	3656	3656	3654	3655	3654	3656	3656	0.1%	3654	3656	3656	3656	3656	3654	3654	
CE110	3637	3637	3636	3637	3636	3637	3637	0.0%	3636	3637	3637	3637	3637	3636	3636	
CE120	3632	3632	3630	3632	3631	3632	3631	0.0%	3630	3632	3632	3632	3632	3631	3631	
CE130	209	209	207	208	207	209	209	1.3%	207	209	209	209	209	207	207	
CE140	190	190	189	188	188	190	190	1.1%	188	190	190	190	190	189	189	
CE150	4376	4376	4375	4376	4375	4376	4376	0.0%	4375	4376	4376	4376	4376	4376	4376	
CE160	4371	4371	4370	4371	4370	4371	4371	0.0%	4370	4371	4371	4371	4371	4370	4370	
CE165	4388	4388	4386	4387	4386	4388	4387	0.0%	4386	4388	4388	4388	4388	4386	4386	
CE170	2159	2159	2157	2158	2157	2159	2159	0.1%	2157	2159	2159	2159	2159	2157	2157	
CE180	4376	4376	4375	4376	4375	4376	4376	0.0%	4375	4376	4376	4376	4376	4375	4375	
CE185	4396	4396	4394	4395	4393	4395	4395	0.1%	4393	4396	4396	4396	4396	4394	4394	
CE190	557	559	558	558	558	559	559	0.4%	557	559	559	559	559	557	557	
CE195	576	579	577	577	576	578	579	0.5%	576	579	579	579	579	577	577	
CE200	5343	5283	5342	5343	5342	5343	5343	1.1%	5283	5343	5343	5343	5343	5341	5341	
Zone Load, Sensible (kWh,thermal)									Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4	
CE100	3656	3656	3654	3655	3654	3656	3656	0.1%	3654	3656	3656	3656	3656	3654	3654	
CE110	3637	3637	3636	3637	3636	3637	3637	0.0%	3636	3637	3637	3637	3637	3636	3636	
CE120	3632	3632	3630	3632	3631	3632	3631	0.0%	3630	3632	3632	3632	3632	3631	3631	
CE130	209	209	207	208	207	209	209	1.3%	207	209	209	209	209	207	207	
CE140	190	190	189	188	188	190	190	1.1%	188	190	190	190	190	189	189	
CE150	3637	3637	3636	3637	3636	3637	3636	0.0%	3636	3637	3637	3637	3637	3637	3637	
CE160	3632	3632	3630	3632	3631	3632	3631	0.0%	3630	3632	3632	3632	3632	3631	3631	
CE165	3649	3649	3647	3648	3647	3649	3648	0.1%	3647	3649	3649	3649	3649	3647	3647	
CE170	1420	1420	1418	1419	1418	1419	1419	0.1%	1418	1420	1420	1420	1420	1418	1418	
CE180	1420	1420	1418	1419	1418	1419	1419	0.1%	1418	1420	1420	1420	1420	1418	1418	
CE185	1439	1439	1437	1437	1437	1438	1438	0.2%	1437	1439	1439	1439	1439	1437	1437	
CE190	190	190	188	188	188	190	190	1.0%	188	190	190	190	190	188	188	
CE195	209	209	207	208	207	209	209	1.1%	207	209	209	209	209	207	207	
CE200	4122	4062	4121	4122	4121	4122	4122	1.5%	4062	4122	4122	4122	4122	4120	4120	
Zone Load, Latent (kWh,thermal)									Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4	
CE100	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE110	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE120	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE130	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE140	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE150	739	739	739	739	739	739	739	0.1%	739	739	739	739	739	739	739	
CE160	739	739	739	739	739	739	739	0.1%	739	739	739	739	739	739	739	
CE165	739	739	739	739	739	739	739	0.1%	739	739	739	739	739	739	739	
CE170	739	739	739	739	739	739	739	0.1%	739	739	739	739	739	739	739	
CE180	2957	2957	2957	2958	2957	2957	2957	0.0%	2957	2958	2957	2957	2957	2957	2957	
CE185	2957	2957	2957	2958	2957	2957	2957	0.0%	2957	2958	2957	2957	2957	2957	2957	
CE190	367	370	370	370	370	370	370	0.8%	367	370	370	370	370	370	370	
CE195	367	370	370	370	370	370	370	0.8%	367	370	370	370	370	370	370	
CE200	1221	1221	1221	1221	1221	1221	1221	0.0%	1221	1221	1221	1221	1221	1221	1221	

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

Table B16.5.1-6. Latent Coil Load minus Zone Load (Should be 0)

Latent Coil - Zone Load, (Should be 0) (kWh,thermal)									Statistics, All Results			Analytical			08-Sep-13	Autodesk GBS v3.4
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*	Min	Max	TUD	HTAL1	HTAL2	GBS Sep2013 Autodesk GBS	Autodesk GBS v3.4	
CE100	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE110	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE120	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE130	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE140	0	0	0	0	0	0	0	----	0	0	0	0	0	0	0	
CE150	0	0	0	2	-7	0	0	----	-7	2	0	0	0	0	0	
CE160	1	0	0	0	-7	0	0	----	-7	1	0	0	0	0	0	
CE165	1	0	0	1	-6	0	0	----	-6	1	0	0	0	0	0	
CE170	1	0	0	-1	-6	0	0	----	-6	1	0	0	0	0	0	
CE180	1	0	0	-30	-13	0	0	----	-30	1	1	0	-1	0	0	
CE185	2	0	0	-28	-11	0	0	----	-28	2	1	0	-1	0	0	
CE190	3	0	0	-3	-2	0	0	----	-3	3	0	0	0	0	0	
CE195	3	0	0	-3	-1	0	0	----	-3	3	0	0	0	0	0	
CE200	1	0	0	-2	-11	0	0	----	-11	1	0	0	0	0	0	

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-7. Sensitivities for Space Cooling Electricity Consumption

Delta Qtot (kWh,e)								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	-454	-441	-460	-454	-451	-455	-450	-460	-441	4.1%	-454	-454	-453	-455	-455
CE120-CE110	-65	-77	-50	-62	-63	-60	-60	-77	-50	41.2%	-64	-66	-66	-63	-63
CE120-CE100	-519	-518	-510	-516	-514	-515	-510	-519	-510	1.8%	-518	-520	-520	-518	-518
CE130-CE100	-1421	-1421	-1415	-1413	-1411	-1414	-1402	-1421	-1402	1.3%	-1420	-1421	-1421	-1415	-1415
CE140-CE130	-42	-40	-40	-40	-41	-41	-41	-42	-40	4.8%	-42	-41	-41	-40	-40
CE140-CE110	-1009	-1020	-996	-999	-1001	-999	-993	-1020	-993	2.6%	-1007	-1009	-1009	-1000	-1000
CE150-CE110	131	118	141	118	128	132	130	118	141	17.9%	130	129	129	116	116
CE160-CE150	-68	-68	-65	-76	-65	-62	-59	-76	-59	25.8%	-66	-67	-68	-75	-75
CE165-CE160	362	362	362	363	359	363	357	357	363	1.7%	357	360	361	364	364
CE170-CE150	-570	-569	-573	-563	-562	-563	-556	-573	-556	3.1%	-565	-569	-569	-562	-562
CE180-CE150	-125	-125	-125	-103	-115	-118	-112	-125	-103	18.0%	-124	-124	-125	-105	-105
CE180-CE170	445	444	448	460	447	445	444	444	460	3.6%	442	445	444	457	457
CE185-CE180	461	461	464	467	458	460	458	458	467	1.9%	462	461	461	460	460
CE190-CE180	-919	-918	-917	-920	-918	-917	-915	-920	-915	0.6%	-917	-918	-918	-915	-915
CE190-CE140	96	95	95	94	96	96	96	94	96	2.6%	96	96	96	96	96
CE195-CE190	86	86	85	86	86	86	86	85	86	2.0%	87	86	86	86	86
CE195-CE185	-1294	-1293	-1296	-1301	-1290	-1292	-1287	-1301	-1287	1.1%	-1292	-1293	-1293	-1289	-1289
CE195-CE130	140	141	140	140	142	141	141	140	142	1.5%	142	141	141	142	142
CE200-CE100	-54	-66	-53	-79	-55	-42	-32	-79	-32	87.3%	-55	-53	-54	-77	-77
Del Qcomp (kWh,e)								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	-430	-419	-442	-428	-432	-427	-427	-442	-419	5.3%	-431	-430	-430	-428	-428
CE120-CE110	-49	-59	-16	-45	-45	-44	-44	-59	-16	87.9%	-47	-50	-50	-46	-46
CE120-CE100	-479	-478	-457	-473	-475	-471	-471	-479	-457	4.5%	-478	-480	-480	-474	-474
CE130-CE100	-1224	-1224	-1214	-1218	-1218	-1208	-1208	-1224	-1208	1.3%	-1224	-1225	-1225	-1219	-1219
CE140-CE130	-38	-37	-38	-37	-38	-38	-38	-38	-37	3.7%	-38	-38	-38	-37	-37
CE140-CE110	-832	-842	-811	-827	-823	-819	-819	-842	-811	3.7%	-831	-833	-833	-828	-828
CE150-CE110	111	100	141	99	113	113	111	99	141	38.3%	111	110	110	98	98
CE160-CE150	-50	-50	-44	-56	-45	-42	-42	-56	-42	27.5%	-49	-50	-50	-54	-54
CE165-CE160	333	332	329	330	333	328	328	328	333	1.6%	328	331	331	330	330
CE170-CE150	-469	-469	-468	-459	-464	-458	-458	-469	-458	2.3%	-466	-469	-469	-458	-458
CE180-CE150	-91	-91	-93	-70	-85	-80	-80	-93	-70	25.0%	-91	-91	-92	-71	-71
CE180-CE170	378	378	375	389	379	378	378	375	389	3.6%	375	378	378	387	387
CE185-CE180	431	431	428	432	430	428	428	428	432	0.9%	432	431	431	427	427
CE190-CE180	-771	-770	-775	-774	-770	-768	-768	-775	-768	0.9%	-770	-770	-770	-772	-772
CE190-CE140	81	81	85	82	82	82	82	81	85	4.5%	82	81	81	83	83
CE195-CE190	79	79	79	79	79	80	80	79	80	0.8%	80	79	79	80	80
CE195-CE185	-1123	-1122	-1124	-1127	-1120	-1116	-1116	-1127	-1116	1.0%	-1121	-1122	-1121	-1118	-1118
CE195-CE130	122	123	126	124	123	123	123	122	126	3.0%	123	122	123	126	126
CE200-CE100	-69	-79	-58	-93	-58	-50	-50	-93	-50	62.3%	-70	-69	-69	-91	-91
Del Q IDfan (kWh,e)								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	-16	-15	-12	-19	-16	-16	-16	-19	-12	41.9%	-16	-16	-16	-19	-19
CE120-CE110	-11	-12	-23	-12	-11	-11	-11	-23	-11	111.4%	-11	-11	-11	-13	-13
CE120-CE100	-27	-27	-36	-31	-27	-27	-27	-36	-27	32.2%	-27	-27	-27	-32	-32
CE130-CE100	-134	-134	-137	-133	-133	-133	-133	-137	-132	3.7%	-134	-134	-134	-133	-133
CE140-CE130	-2	-2	-1	-2	-2	-2	-2	-2	-1	36.7%	-2	-2	-2	-2	-2
CE140-CE110	-120	-121	-126	-116	-119	-120	-118	-126	-116	8.3%	-120	-120	-120	-116	-116
CE150-CE110	13	12	0	14	13	13	13	0	14	106.4%	13	13	13	13	13
CE160-CE150	-12	-12	-14	-15	-12	-12	-11	-15	-11	32.6%	-12	-12	-12	-15	-15
CE165-CE160	20	21	23	24	20	20	20	20	24	21.6%	20	20	20	25	25
CE170-CE150	-68	-68	-72	-73	-67	-68	-66	-73	-66	9.7%	-68	-68	-68	-73	-73
CE180-CE150	-23	-22	-22	-24	-22	-21	-21	-24	-21	12.1%	-22	-23	-23	-25	-25
CE180-CE170	45	46	49	49	45	45	45	45	49	9.9%	45	45	45	48	48
CE185-CE180	21	20	24	25	21	21	21	20	25	24.1%	21	21	21	24	24
CE190-CE180	-100	-101	-97	-98	-100	-100	-100	-101	-97	4.3%	-101	-101	-101	-96	-96
CE190-CE140	10	10	7	8	10	10	10	7	10	28.2%	10	10	10	8	8
CE195-CE190	5	5	4	4	5	5	5	4	5	30.8%	5	5	5	4	4
CE195-CE185	-116	-116	-117	-119	-116	-117	-116	-119	-116	2.6%	-117	-117	-117	-117	-117
CE195-CE130	13	13	9	10	12	12	12	9	13	29.1%	12	12	12	10	10
CE200-CE100	10	9	4	10	10	11	12	4	12	78.4%	10	11	11	10	10
Del Q ODfan (kWh,e)								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	-8	-7	-6	-7	-7	-7	-7	-8	-6	29.9%	-7	-7	-7	-7	-7
CE120-CE110	-5	-6	-11	-5	-5	-5	-5	-11	-5	114.1%	-5	-5	-5	-5	-5
CE120-CE100	-13	-13	-17	-12	-13	-13	-13	-17	-12	37.1%	-13	-13	-13	-12	-12
CE130-CE100	-63	-63	-64	-62	-63	-62	-62	-64	-62	3.7%	-63	-63	-63	-63	-63
CE140-CE130	-1	-1	-1	-1	-1	-1	-1	-1	-1	37.5%	-1	-1	-1	-1	-1
CE140-CE110	-56	-57	-59	-56	-56	-56	-56	-59	-56	6.3%	-56	-56	-56	-56	-56
CE150-CE110	6	5	0	5	6	6	6	0	6	100.7%	6	6	6	5	5
CE160-CE150	-5	-5	-7	-5	-6	-5	-5	-7	-5	27.1%	-6	-6	-6	-6	-6
CE165-CE160	9	9	11	9	10	9	9	9	11	17.3%	9	9	9	10	10
CE170-CE150	-32	-32	-34	-31	-32	-31	-31	-34	-31	8.2%	-32	-32	-32	-31	-31
CE180-CE150	-10	-10	-10	-9	-11	-10	-10	-11	-9	14.3%	-11	-11	-11	-10	-10
CE180-CE170	22	22	23	22	21	21	21	21	23	9.6%	21	21	21	22	22
CE185-CE180	9	9	11	10	10	10	10	9	11	24.6%	10	10	10	10	10
CE190-CE180	-48	-47	-45	-48	-47	-47	-47	-48	-45	5.5%	-47	-47	-47	-47	-47
CE190-CE140	4	5	3	4	5	5	5	3	5	34.5%	5	5	5	5	5
CE195-CE190	3	2	2	3	2	2	2	2	3	62.1%	2	2	2	2	2
CE195-CE185	-54	-54	-55	-55	-55	-54	-54	-55	-54	2.0%	-55	-55	-55	-54	-54
CE195-CE130	6	6	4	6	6	6	6	4	6	27.2%	6	6	6	6	6
CE200-CE100	5	4	2	4	5	6	6	2	6	77.9%	5	5	5	4	4

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-8. Sensitivities for COP and Coil Loads

Delta COP (kWh,t)								Statistics, All Results					08-Sep-13		
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*			Analytical			GBS Sep2013	Autodesk GBS v3.4
								Min	Max		TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	0.99	0.95	1.03	1.01	1.00	1.01	1.01	0.95	1.03	7.6%	0.99	0.99	0.99	1.01	1.01
CE120-CE110	0.21	0.25	0.16	0.21	0.21	0.20	0.20	0.16	0.25	44.5%	0.21	0.21	0.21	0.21	0.21
CE120-CE100	1.20	1.20	1.18	1.22	1.20	1.20	1.21	1.18	1.22	2.8%	1.20	1.20	1.20	1.22	1.22
CE130-CE100	-0.48	-0.48	-0.46	-0.45	-0.50	-0.48	-0.50	-0.50	-0.45	10.0%	-0.50	-0.48	-0.48	-0.45	-0.45
CE140-CE130	0.86	0.83	0.94	0.90	0.87	0.88	0.88	0.83	0.94	13.4%	0.86	0.86	0.86	0.90	0.90
CE140-CE110	-0.61	-0.61	-0.54	-0.56	-0.63	-0.61	-0.63	-0.63	-0.54	13.9%	-0.63	-0.61	-0.61	-0.56	-0.56
CE150-CE110	0.24	0.29	0.21	0.29	0.25	0.24	0.25	0.21	0.29	31.9%	0.25	0.25	0.25	0.29	0.29
CE160-CE150	0.22	0.21	0.20	0.25	0.21	0.20	0.19	0.19	0.25	30.4%	0.21	0.21	0.21	0.24	0.24
CE165-CE160	-0.92	-0.92	-0.91	-0.96	-0.92	-0.92	-0.92	-0.96	-0.91	5.5%	-0.90	-0.91	-0.91	-0.96	-0.96
CE170-CE150	-0.24	-0.24	-0.23	-0.22	-0.26	-0.26	-0.27	-0.27	-0.22	19.1%	-0.26	-0.24	-0.24	-0.23	-0.23
CE180-CE150	0.42	0.41	0.42	0.33	0.39	0.40	0.38	0.33	0.42	22.8%	0.42	0.41	0.41	0.36	0.36
CE180-CE170	0.66	0.65	0.64	0.55	0.65	0.65	0.65	0.55	0.66	16.9%	0.68	0.65	0.65	0.59	0.59
CE185-CE180	-1.19	-1.19	-1.21	-1.20	-1.19	-1.20	-1.20	-1.21	-1.19	1.7%	-1.20	-1.19	-1.19	-1.20	-1.20
CE190-CE180	-0.63	-0.63	-0.60	-0.57	-0.65	-0.64	-0.65	-0.65	-0.57	12.7%	-0.66	-0.63	-0.63	-0.62	-0.62
CE190-CE140	0.64	0.68	0.57	0.60	0.62	0.61	0.61	0.57	0.68	16.4%	0.64	0.64	0.64	0.59	0.59
CE195-CE190	-1.10	-1.10	-1.13	-1.12	-1.09	-1.09	-1.10	-1.13	-1.09	3.3%	-1.09	-1.10	-1.10	-1.12	-1.12
CE195-CE185	-0.54	-0.54	-0.51	-0.49	-0.55	-0.54	-0.55	-0.55	-0.49	12.1%	-0.55	-0.54	-0.54	-0.53	-0.53
CE195-CE130	0.40	0.40	0.38	0.38	0.40	0.40	0.39	0.38	0.40	4.2%	0.40	0.40	0.40	0.37	0.37
CE200-CE100	1.23	1.22	1.24	1.30	1.24	1.21	1.19	1.19	1.30	8.9%	1.23	1.23	1.23	1.30	1.30
Del Q coil,t (kWh,t)								Statistics, All Results					08-Sep-13		
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*			Analytical			GBS Sep2013	Autodesk GBS v3.4
								Min	Max		TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	-35	-34	-38	-38	-35	-35	-35	-38	-34	12.5%	-35	-35	-35	-37	-37
CE120-CE110	-16	-17	-40	-16	-16	-16	-16	-40	-16	146.5%	-16	-16	-17	-17	-17
CE120-CE100	-51	-51	-78	-55	-51	-51	-51	-78	-51	52.7%	-51	-52	-52	-55	-55
CE130-CE100	-3581	-3581	-3626	-3579	-3581	-3581	-3578	-3626	-3578	1.3%	-3581	-3581	-3581	-3580	-3580
CE140-CE130	-21	-21	-20	-21	-21	-21	-21	-21	-20	4.9%	-21	-21	-22	-20	-20
CE140-CE110	-3567	-3568	-3608	-3561	-3567	-3567	-3565	-3608	-3561	1.3%	-3567	-3567	-3568	-3563	-3563
CE150-CE110	752	751	739	772	746	752	752	739	772	4.4%	752	752	753	769	769
CE160-CE150	-16	-17	-26	-19	-18	-17	-16	-26	-16	59.5%	-17	-17	-18	-20	-20
CE165-CE160	37	38	51	40	38	37	36	36	51	40.0%	36	37	38	40	40
CE170-CE150	-2284	-2285	-2317	-2291	-2284	-2285	-2283	-2317	-2283	1.5%	-2285	-2286	-2286	-2291	-2291
CE180-CE150	-22	-22	-33	7	-28	-22	-21	-33	7	172.5%	-22	-23	-25	34	34
CE180-CE170	2262	2263	2284	2298	2256	2263	2262	2256	2298	1.8%	2263	2263	2261	2325	2325
CE185-CE180	12	40	55	48	41	40	40	12	55	107.3%	40	40	40	45	45
CE190-CE180	-3917	-3918	-3937	-3956	-3907	-3917	-3916	-3956	-3907	1.3%	-3918	-3918	-3916	-3980	-3980
CE190-CE140	380	379	377	384	378	380	379	377	384	1.8%	380	379	380	386	386
CE195-CE190	24	24	23	23	23	24	24	23	24	5.8%	24	24	24	24	24
CE195-CE185	-3905	-3934	-3970	-3981	-3925	-3934	-3933	-3981	-3905	1.9%	-3934	-3934	-3933	-4001	-4001
CE195-CE130	383	382	379	387	381	382	382	379	387	1.9%	382	382	382	389	389
CE200-CE100	1698	1636	1693	1728	1687	1698	1700	1636	1728	5.4%	1697	1697	1697	1726	1726
Del Q coil,s (kWh,t)								Statistics, All Results					08-Sep-13		
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*			Analytical			GBS Sep2013	Autodesk GBS v3.4
								Min	Max		TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	-35	-34	-38	-38	-35	-35	-35	-38	-34	12.5%	-35	-35	-35	-37	-37
CE120-CE110	-16	-17	-40	-16	-16	-16	-16	-40	-16	146.5%	-16	-16	-17	-17	-17
CE120-CE100	-51	-51	-78	-55	-51	-51	-51	-78	-51	52.8%	-51	-52	-52	-55	-55
CE130-CE100	-3581	-3581	-3626	-3579	-3581	-3581	-3578	-3626	-3578	1.3%	-3581	-3581	-3581	-3580	-3580
CE140-CE130	-21	-21	-20	-21	-21	-21	-21	-21	-20	4.9%	-21	-21	-22	-20	-20
CE140-CE110	-3567	-3568	-3608	-3561	-3567	-3567	-3565	-3608	-3561	1.3%	-3567	-3567	-3568	-3563	-3563
CE150-CE110	13	12	0	30	13	13	13	0	30	228.7%	13	13	14	30	30
CE160-CE150	-17	-17	-26	-17	-17	-17	-16	-26	-16	58.9%	-17	-17	-18	-20	-20
CE165-CE160	37	37	51	40	36	37	36	36	51	40.1%	36	37	38	40	40
CE170-CE150	-2285	-2285	-2317	-2288	-2285	-2285	-2283	-2317	-2283	1.5%	-2285	-2286	-2286	-2291	-2291
CE180-CE150	-2241	-2240	-2250	-2179	-2239	-2240	-2239	-2250	-2179	3.2%	-2241	-2240	-2241	-2184	-2184
CE180-CE170	44	45	66	109	46	45	45	44	109	144.8%	45	45	45	107	107
CE185-CE180	11	40	55	46	39	40	40	11	55	110.0%	40	40	40	45	45
CE190-CE180	-1329	-1330	-1350	-1394	-1331	-1330	-1329	-1394	-1329	4.9%	-1330	-1330	-1330	-1392	-1392
CE190-CE140	10	10	7	18	10	10	9	7	18	100.3%	10	10	11	17	17
CE195-CE190	24	24	23	23	23	24	24	23	24	5.7%	24	24	24	24	24
CE195-CE185	-1316	-1346	-1382	-1418	-1347	-1346	-1345	-1418	-1316	7.6%	-1346	-1347	-1346	-1414	-1414
CE195-CE130	13	13	10	20	13	12	12	10	20	81.6%	12	12	12	20	20
CE200-CE100	476	415	472	509	477	477	479	415	509	19.7%	476	476	476	505	505
Del Qcoil,lat (kWh,t)								Statistics, All Results					08-Sep-13		
Case	CA-SIS EDF	CLM2000 EDF	DOE21E CIEMAT	DOE21E NREL	E+ GARD	TRN-id TUD	TRN-re TUD	(Max-Min) /Analytical*			Analytical			GBS Sep2013	Autodesk GBS v3.4
								Min	Max		TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE110-CE100	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE120-CE110	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE120-CE100	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE130-CE100	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE140-CE130	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE140-CE110	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE150-CE110	739	739	739	742	733	739	739	733	742	1.2%	739	739	739	739	739
CE160-CE150	1	0	0	-2	-1	0	0	-2	1	----	0	0	0	0	0
CE165-CE160	0	0	0	1	1	0	0	0	1	----	0	0	0	0	0
CE170-CE150	1	0	0	-3	1	0	0	-3	1	----	0	0	0	0	0
CE180-CE150	2219	2218	2218	2186	2211	2218	2218	2186	2219	1.5%	2218	2218	2217	2218	2218
CE180-CE170	2218	2218	2218	2189	2210	2218	2218	2189	2218	1.3%	2218	2218	2217	2218	2218
CE185-CE180	1	0	0	2	2	0	0	0	2	----	0	0	0	0	0
CE190-CE180	-2588	-2587	-2587	-2562	-2576	-2587	-2587	-2588	-2562	----	-2588	-2587	-2586	-2587	-2587
CE190-CE140	370	370	370	366	368	370	370	366	370	1.0%	370	370	370	370	370
CE195-CE190	0	0	0	0	0	0	0	0	0	----	0	0	0	0	0
CE195-CE185	-2589	-2587	-2587	-2563	-2578	-2587	-2587	-2589	-2563	----	-2588	-2587	-2587	-2587	-2587
CE195-CE130	370	370	370	367	368	370	370	367	370	0.9%	370	370	370	370	370
CE200-CE100	1222	1221	1221	1219	1210	1221	1221	1210	1222	1.0%	1221	1221	1221	1221	1221

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

ASHRAE Standard 140-2011 Test Results Comparison for Section 5.3 - HVAC Equipment Performance Tests CE100-CE200
Autodesk Green Building Studio September 8, 2013 (GBS Sep2013) vs. Annex B16, Section B16.5.1 Example Results
By Autodesk Green Building Studio (Autodesk GBS), 08-Sep-2013

Note: The statistics in the tables below are based on the Standard 140 informative example results.
 These statistics do not have any substantial importance and are not to be interpreted as acceptance criteria.

Table B16.5.1-9. Indoor Drybulb Temperature: Mean and (Max-Min)/Mean

Mean IDB (°C)								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE100	22.2	22.2	22.3	22.3	22.2	22.2	22.6	22.2	22.6	2.0%	22.2	22.2	22.2	22.3	22.3
CE110	22.2	22.2	22.3	22.3	22.2	22.2	22.5	22.2	22.5	1.5%	22.2	22.2	22.2	22.3	22.3
CE120	26.7	26.7	26.8	26.7	26.7	26.7	27.1	26.7	27.1	1.4%	26.7	26.7	26.7	26.8	26.8
CE130	22.2	22.2	22.1	22.1	22.2	22.2	21.6	21.6	22.2	2.5%	22.2	22.2	22.2	22.1	22.1
CE140	22.2	22.2	22.1	22.1	22.2	22.2	21.5	21.5	22.2	3.1%	22.2	22.2	22.2	22.1	22.1
CE150	22.2	22.2	22.3	22.3	22.2	22.2	22.7	22.2	22.7	2.1%	22.2	22.2	22.2	22.3	22.3
CE160	26.7	26.7	26.8	26.7	26.7	26.7	27.0	26.7	27.0	1.1%	26.7	26.7	26.7	26.8	26.8
CE165	23.3	23.3	23.4	23.4	23.3	23.3	23.8	23.3	23.8	2.1%	23.3	23.3	23.3	23.4	23.4
CE170	22.2	22.2	22.2	22.2	22.2	22.2	22.1	22.1	22.2	0.5%	22.2	22.2	22.2	22.2	22.2
CE180	22.2	22.2	22.3	22.3	22.2	22.2	22.3	22.2	22.3	0.6%	22.2	22.2	22.2	22.3	22.3
CE185	22.2	22.2	22.3	22.3	22.2	22.2	22.4	22.2	22.4	0.8%	22.2	22.2	22.2	22.3	22.3
CE190	22.2	22.2	22.1	22.1	22.2	22.2	21.9	21.9	22.2	1.1%	22.2	22.2	22.2	22.1	22.1
CE195	22.2	22.2	22.1	22.1	22.2	22.2	22.0	22.0	22.2	0.9%	22.2	22.2	22.2	22.1	22.1
CE200	26.7	26.7	26.8	26.8	26.7	26.7	26.7	26.7	26.8	0.4%	26.7	26.7	26.7	26.9	26.9

(Max - Min)/Mean IDB (°C)								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE100	0.000	0.000	0.000	0.000	0.000	0.000	0.049	0.000	0.049	----	0.000	0.000	0.002	0.000	0.000
CE110	0.000	0.000	0.000	0.000	0.000	0.000	0.048	0.000	0.048	----	0.000	0.000	0.002	0.000	0.000
CE120	0.000	0.000	0.000	0.000	0.000	0.000	0.077	0.000	0.077	----	0.000	0.000	0.002	0.000	0.000
CE130	0.000	0.000	0.000	0.000	0.000	0.000	0.056	0.000	0.056	----	0.000	0.000	0.001	0.000	0.000
CE140	0.000	0.000	0.000	0.000	0.000	0.000	0.069	0.000	0.069	----	0.000	0.000	0.002	0.000	0.000
CE150	0.000	0.000	0.000	0.000	0.000	0.000	0.054	0.000	0.054	----	0.000	0.000	0.002	0.000	0.000
CE160	0.000	0.000	0.000	0.000	0.000	0.000	0.045	0.000	0.045	----	0.000	0.000	0.002	0.000	0.000
CE165	0.000	0.000	0.000	0.000	0.000	0.000	0.051	0.000	0.051	----	0.000	0.000	0.002	0.000	0.000
CE170	0.000	0.000	0.000	0.000	0.000	0.000	0.050	0.000	0.050	----	0.000	0.000	0.001	0.000	0.000
CE180	0.000	0.000	0.000	0.000	0.000	0.000	0.035	0.000	0.035	----	0.000	0.000	0.001	0.000	0.000
CE185	0.000	0.000	0.000	0.000	0.000	0.000	0.021	0.000	0.021	----	0.000	0.000	0.001	0.000	0.000
CE190	0.000	0.000	0.000	0.000	0.000	0.000	0.028	0.000	0.028	----	0.000	0.000	0.001	0.000	0.000
CE195	0.000	0.000	0.000	0.000	0.000	0.000	0.023	0.000	0.023	----	0.000	0.000	0.001	0.000	0.000
CE200	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000	----	0.000	0.000	0.000	0.000	0.000

* ABS[(Max-Min)/(Mean of Analytical Solutions)]

Table B16.5.1-10. Humidity Ratio: Mean and (Max-Min)/Mean

Mean Humidity Ratio								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE100	0.0075	0.0069	0.0076	0.0074	0.0075	0.0075	0.0075	0.0069	0.0076	9.4%	0.0074	0.0073	0.0073	0.0074	0.0074
CE110	0.0066	0.0069	0.0070	0.0064	0.0066	0.0066	0.0066	0.0064	0.0070	9.8%	0.0065	0.0064	0.0064	0.0064	0.0064
CE120	0.0080	0.0070	0.0078	0.0078	0.0080	0.0080	0.0080	0.0070	0.0080	13.2%	0.0079	0.0079	0.0079	0.0078	0.0078
CE130	0.0075	0.0069	0.0076	0.0073	0.0075	0.0075	0.0075	0.0069	0.0076	9.4%	0.0074	0.0073	0.0073	0.0073	0.0073
CE140	0.0065	0.0069	0.0071	0.0064	0.0066	0.0066	0.0066	0.0064	0.0071	10.2%	0.0065	0.0064	0.0064	0.0064	0.0064
CE150	0.0083	0.0085	0.0082	0.0083	0.0084	0.0083	0.0085	0.0082	0.0085	4.0%	0.0082	0.0082	0.0082	0.0082	0.0082
CE160	0.0102	0.0101	0.0097	0.0099	0.0103	0.0101	0.0102	0.0097	0.0103	5.8%	0.0100	0.0099	0.0099	0.0099	0.0099
CE165	0.0093	0.0099	0.0090	0.0092	0.0094	0.0093	0.0095	0.0090	0.0099	9.2%	0.0093	0.0092	0.0092	0.0092	0.0092
CE170	0.0106	0.0107	0.0105	0.0105	0.0106	0.0105	0.0105	0.0105	0.0107	2.2%	0.0104	0.0105	0.0105	0.0105	0.0105
CE180	0.0164	0.0164	0.0166	0.0164	0.0162	0.0163	0.0164	0.0162	0.0166	2.6%	0.0162	0.0162	0.0162	0.0165	0.0165
CE185	0.0162	0.0171	0.0164	0.0162	0.0161	0.0162	0.0163	0.0161	0.0171	6.4%	0.0161	0.0161	0.0161	0.0164	0.0164
CE190	0.0160	0.0161	0.0163	0.0159	0.0159	0.0159	0.0157	0.0157	0.0163	3.5%	0.0158	0.0159	0.0159	0.0161	0.0161
CE195	0.0156	0.0164	0.0158	0.0155	0.0154	0.0155	0.0153	0.0153	0.0164	7.0%	0.0154	0.0154	0.0154	0.0156	0.0156
CE200	0.0114	0.0115	0.0109	0.0111	0.0115	0.0113	0.0113	0.0109	0.0115	5.1%	0.0111	0.0111	0.0111	0.0111	0.0111

(Max - Min)/Mean Humidity Ratio								Statistics, All Results					08-Sep-13		
Case	CA-SIS	CLM2000	DOE21E	DOE21E	E+	TRN-id	TRN-re	(Max-Min)			Analytical			GBS Sep2013	Autodesk GBS v3.4
	EDF	EDF	CIEMAT	NREL	GARD	TUD	TUD	Min	Max	/Analytical*	TUD	HTAL1	HTAL2	Autodesk GBS	Autodesk GBS v3.4
CE100	0.000	0.022	0.000	0.000	0.001	0.000	0.000	0.0000	0.0217	----	0.000	0.000	0.000	0.000	0.000
CE110	0.000	0.022	0.014	0.000	0.000	0.000	0.000	0.0000	0.0217	----	0.000	0.000	0.000	0.000	0.000
CE120	0.000	0.000	0.000	0.000	0.001	0.000	0.000	0.0000	0.0005	----	0.000	0.000	0.000	0.000	0.000
CE130	0.000	0.010	0.000	0.000	0.001	0.000	0.000	0.0000	0.0101	----	0.000	0.000	0.000	0.000	0.000
CE140	0.000	0.012	0.014	0.000	0.001	0.000	0.000	0.0000	0.0142	----	0.000	0.000	0.000	0.000	0.000
CE150	0.012	0.000	0.000	0.000	0.013	0.000	0.013	0.0000	0.0132	----	0.000	0.000	0.000	0.000	0.000
CE160	0.020	0.000	0.010	0.010	0.013	0.000	0.011	0.0000	0.0196	----	0.000	0.000	0.000	0.000	0.000
CE165	0.011	0.001	0.011	0.000	0.013	0.000	0.013	0.0000	0.0131	----	0.000	0.000	0.000	0.000	0.000
CE170	0.000	0.000	0.010	0.000	0.011	0.000	0.024	0.0000	0.0238	----	0.000	0.000	0.001	0.000	0.000
CE180	0.018	0.000	0.012	0.012	0.010	0.000	0.040	0.0000	0.0402	----	0.000	0.000	0.001	0.000	0.000
CE185	0.012	0.006	0.018	0.012	0.011	0.000	0.025	0.0000	0.0246	----	0.000	0.000	0.001	0.000	0.000
CE190	0.000	0.000	0.018	0.019	0.014	0.000	0.031	0.0000	0.0312	----	0.000	0.000	0.001	0.002	0.002
CE195	0.000	0.006	0.019	0.019	0.014	0.000	0.024	0.0000	0.0241	----	0.000	0.000	0.001	0.002	0.002
CE200	0.018	0.000	0.009	0.009	0.013	0.000	0.000	0.0000	0.0175	----	0.000	0.000	0.000	0.000	0.000

* ABS[(Max-Min) / (Mean of Analytical Solutions)]

Figure B16.5.1-15.
HVAC BESTEST: Sensible Coil Load Sensitivities


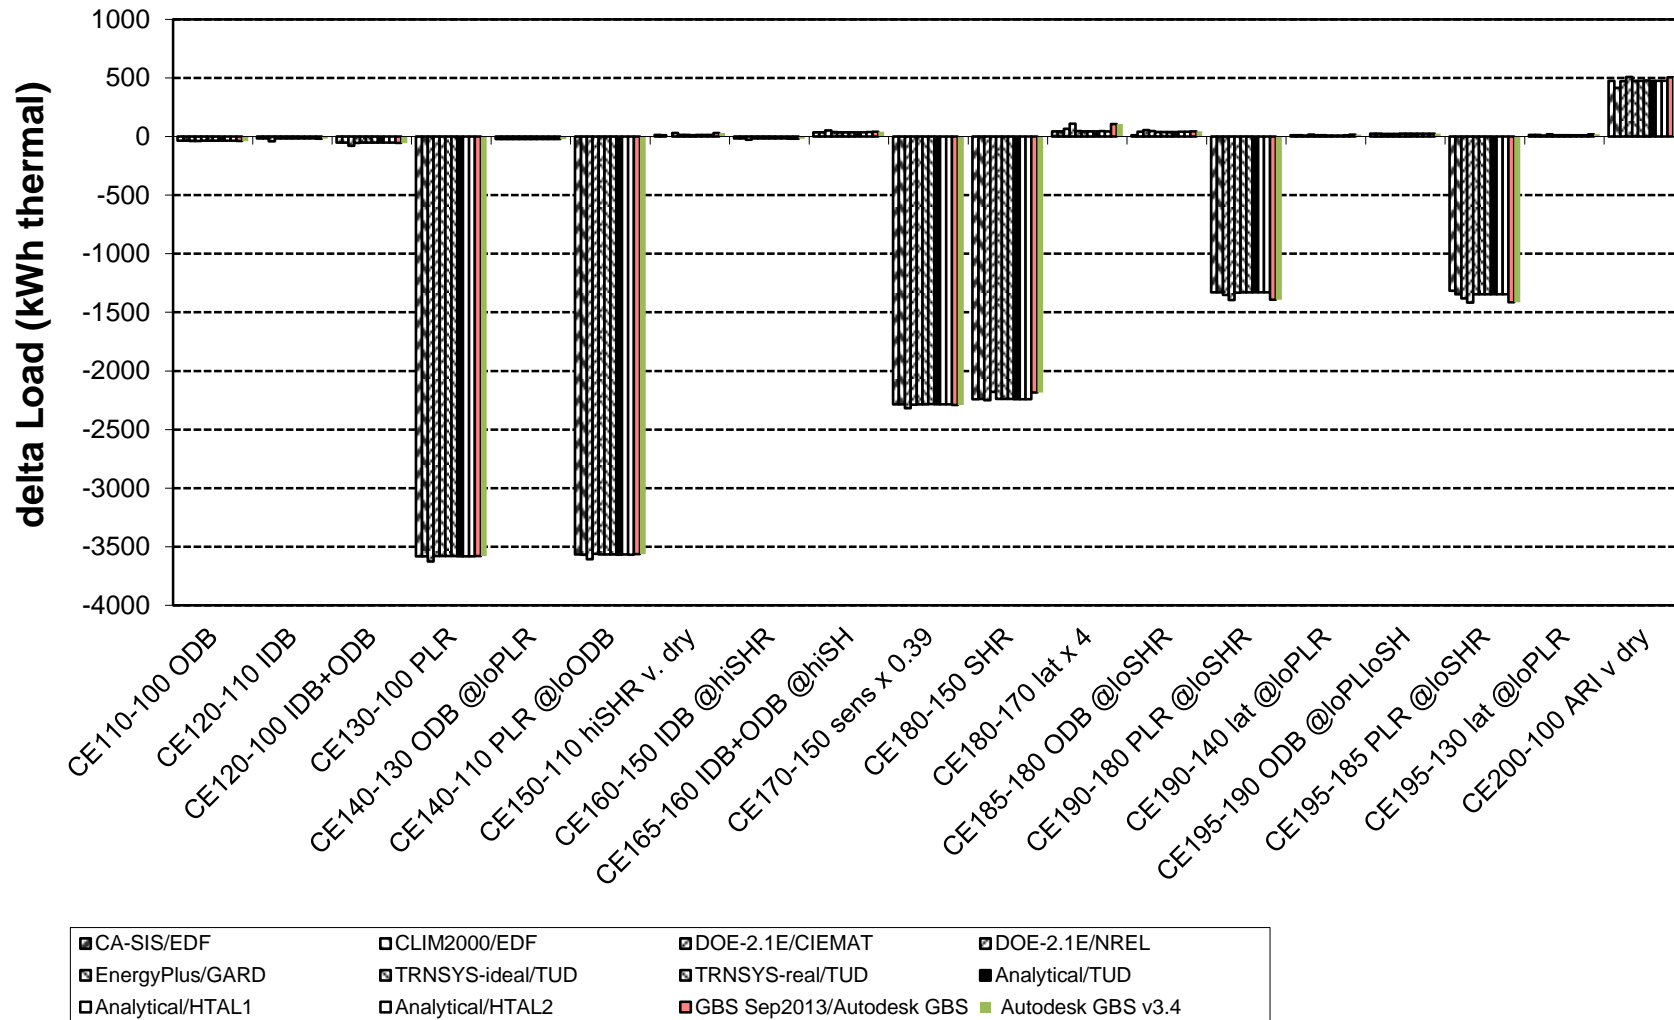


Figure B16.5.1-22.
HVAC BESTEST: Total Zone Load



CA-SIS/EDF	CLIM2000/EDF	DOE-2.1E/CIEMAT	DOE-2.1E/NREL
EnergyPlus/GARD	TRNSYS-ideal/TUD	TRNSYS-real/TUD	Analytical/TUD
Analytical/HTAL1	Analytical/HTAL2	GBS Sep2013/Autodesk GBS	Autodesk GBS v3.4

Figure B16.5.1-26.
HVAC BESTEST: Latent Coil Load - Latent Zone Load (Should = 0)

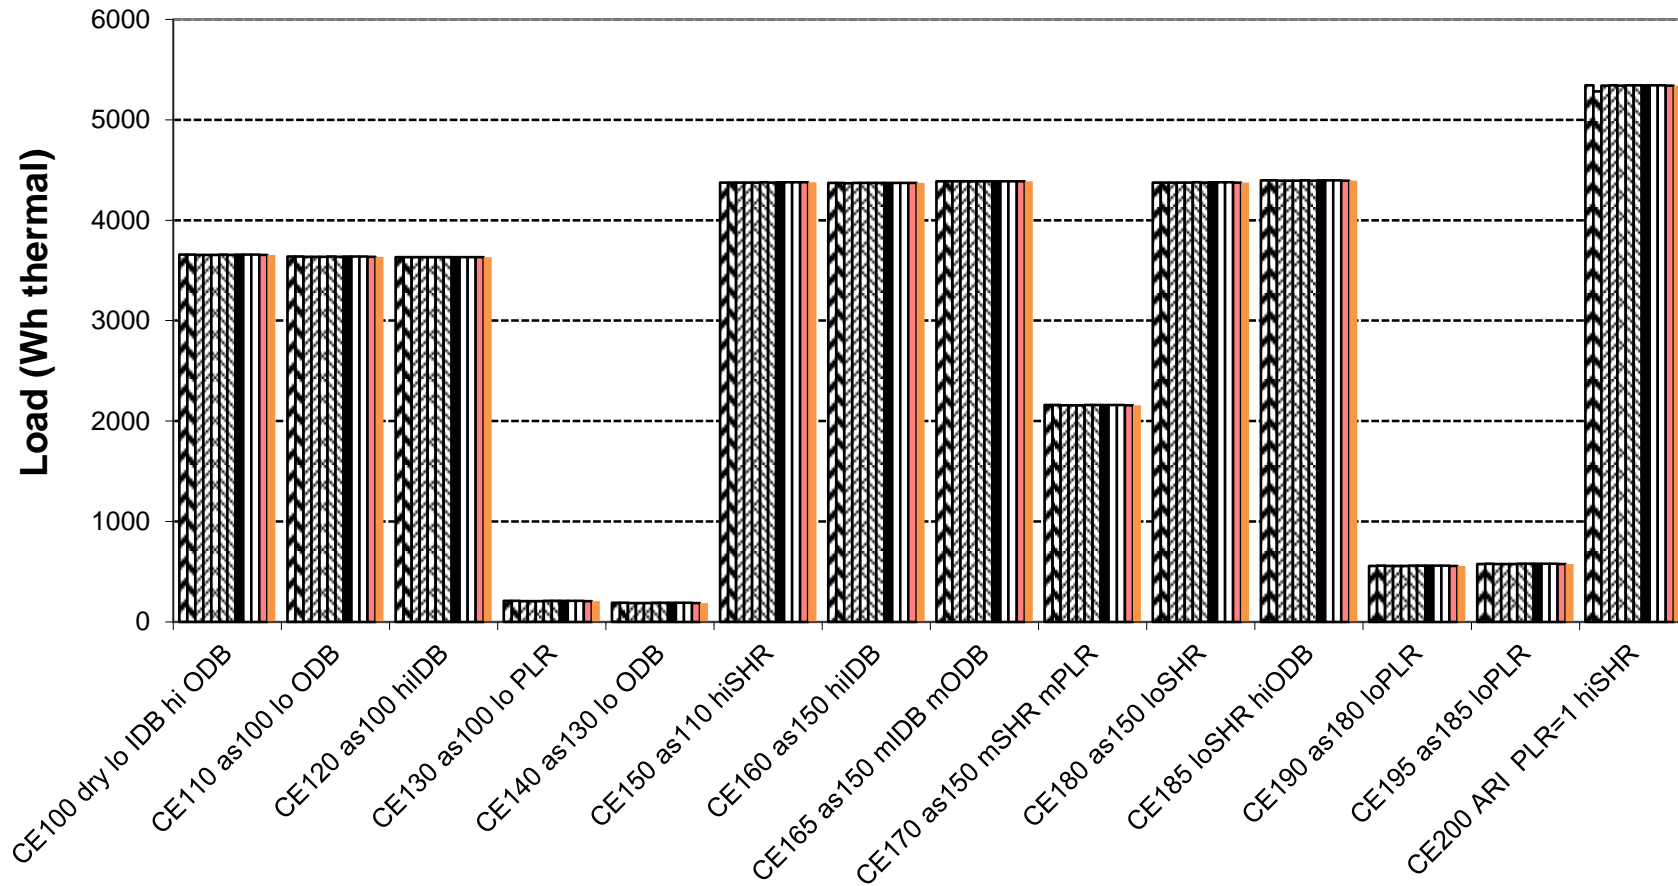